


# 6 REFRIGERANT CYCLE DIAGRAM

## 6-1. Refrigerant Cycle Diagram

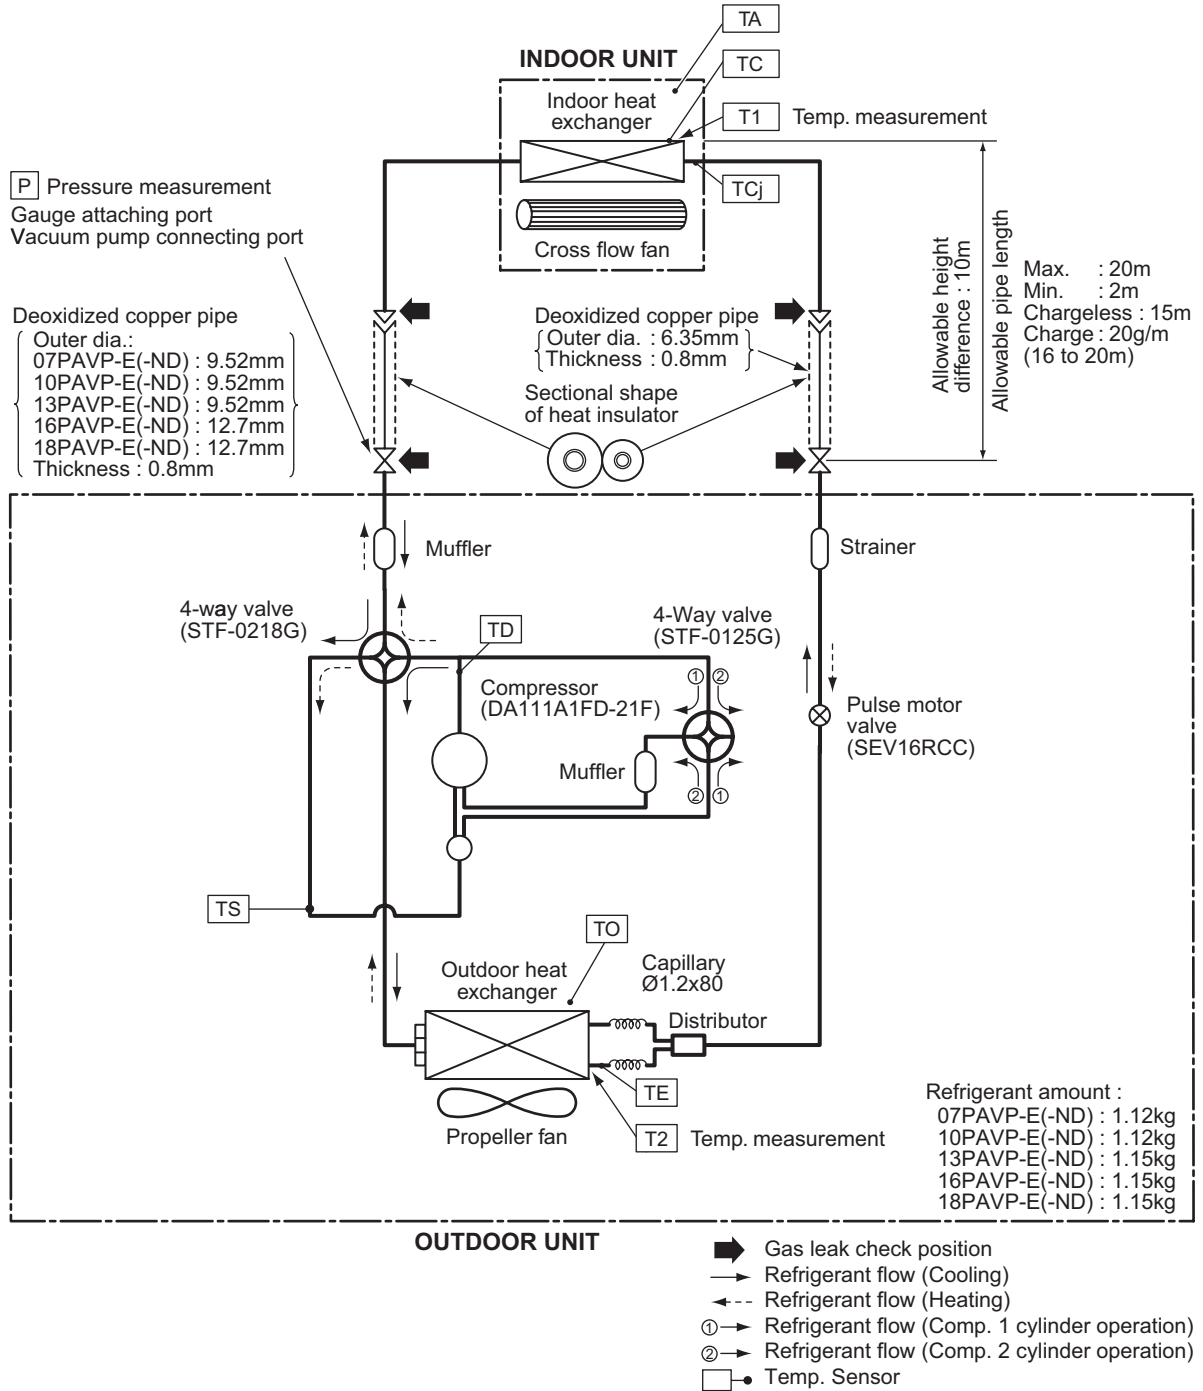

**NOTE**

The maximum pipe length of this air conditioner is 20 m. When the pipe length exceeds 15m, the additional charging of refrigerant, 20g per 1m for the part of pipe exceeded 15m is required. (Max. 100g)